



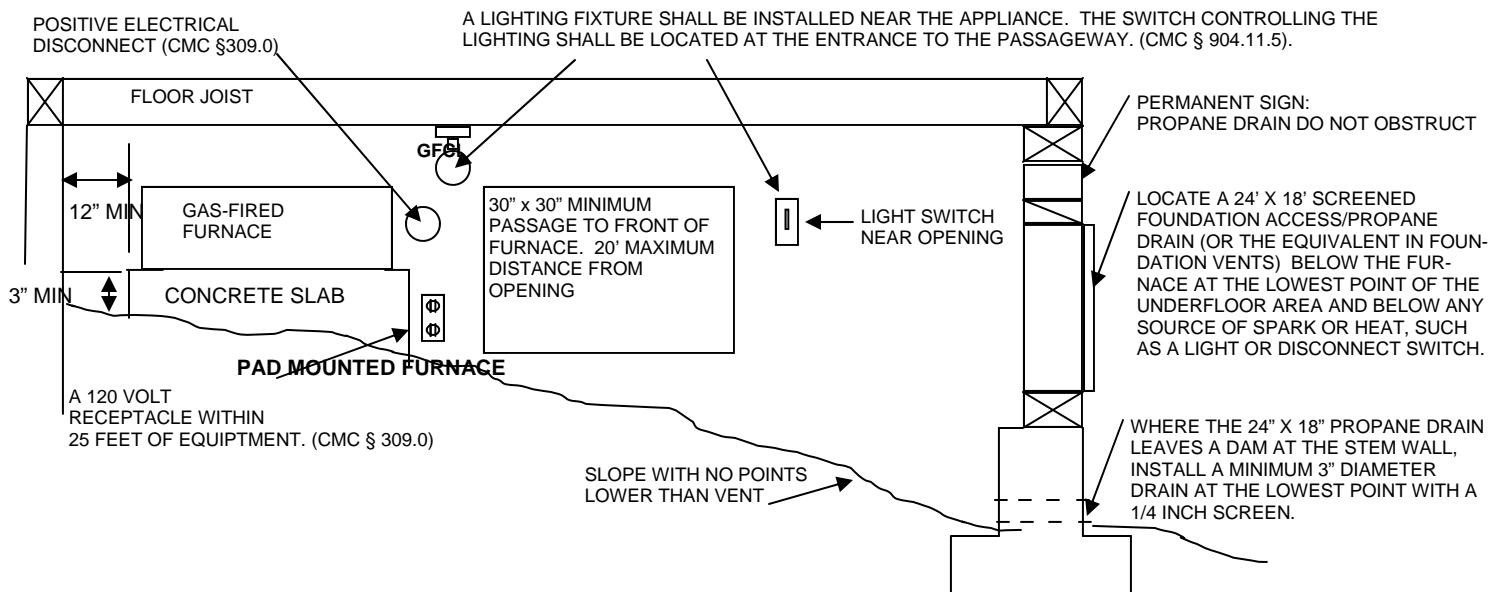

PROPANE APPLIANCE

NOTE: In areas above 2,500 foot elevation the designer of the building must specify an acceptable method of compliance with the California Mechanical Code § 304. This must include the method of protecting the propane drain from snow accumulation such that unburned gas is permitted at all times to escape the building. Where the propane drain is below the maximum anticipated snow depth (see Placer County Code, Table A-16-C), the design of the system must be done by a California licensed mechanical engineer.

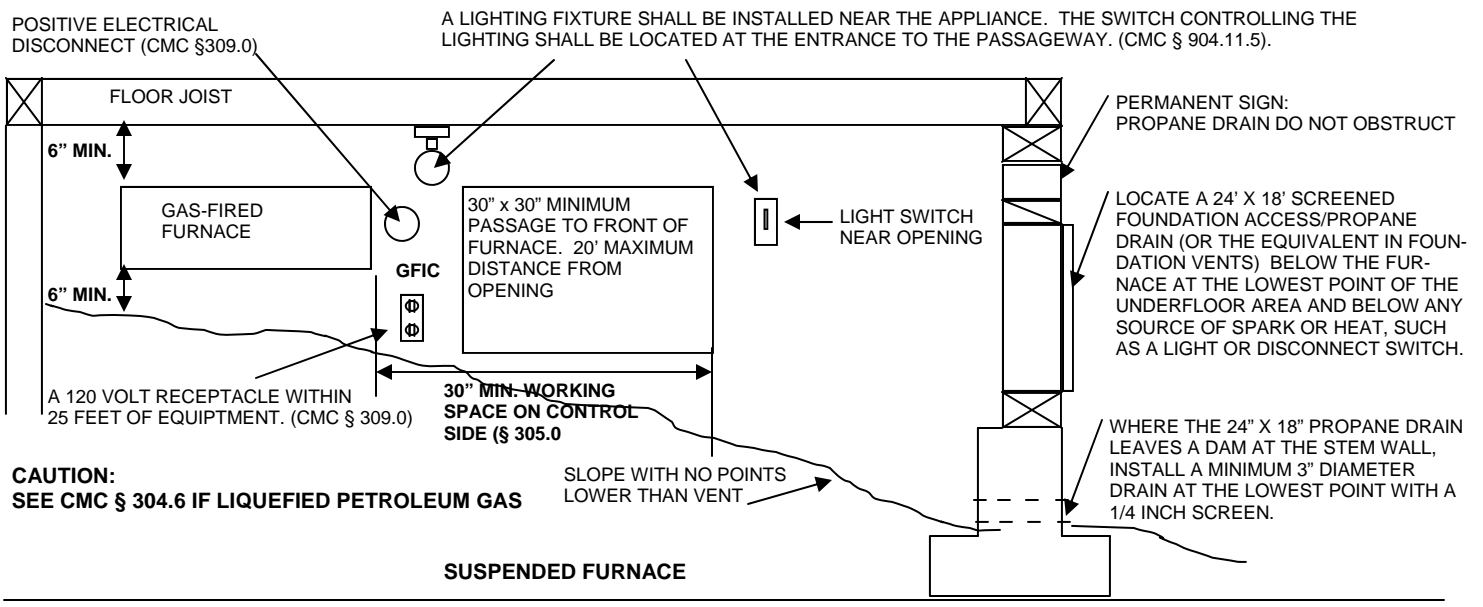

California Mechanical Code § 304.7. Liquefied Petroleum Gas Appliances:

Liquefied petroleum gas-burning appliances shall not be installed in a pit, basement or similar location where heavier-than-air gas might collect. Appliances so fueled shall not be installed in an above-grade under-floor space or basement unless such location is provided with an approved means for removal of unburned gas.